

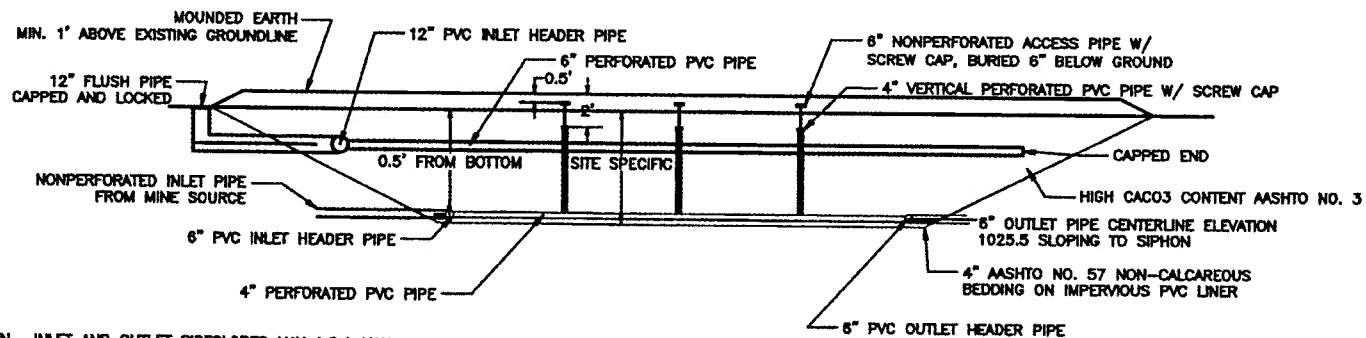


WATER TREATMENT

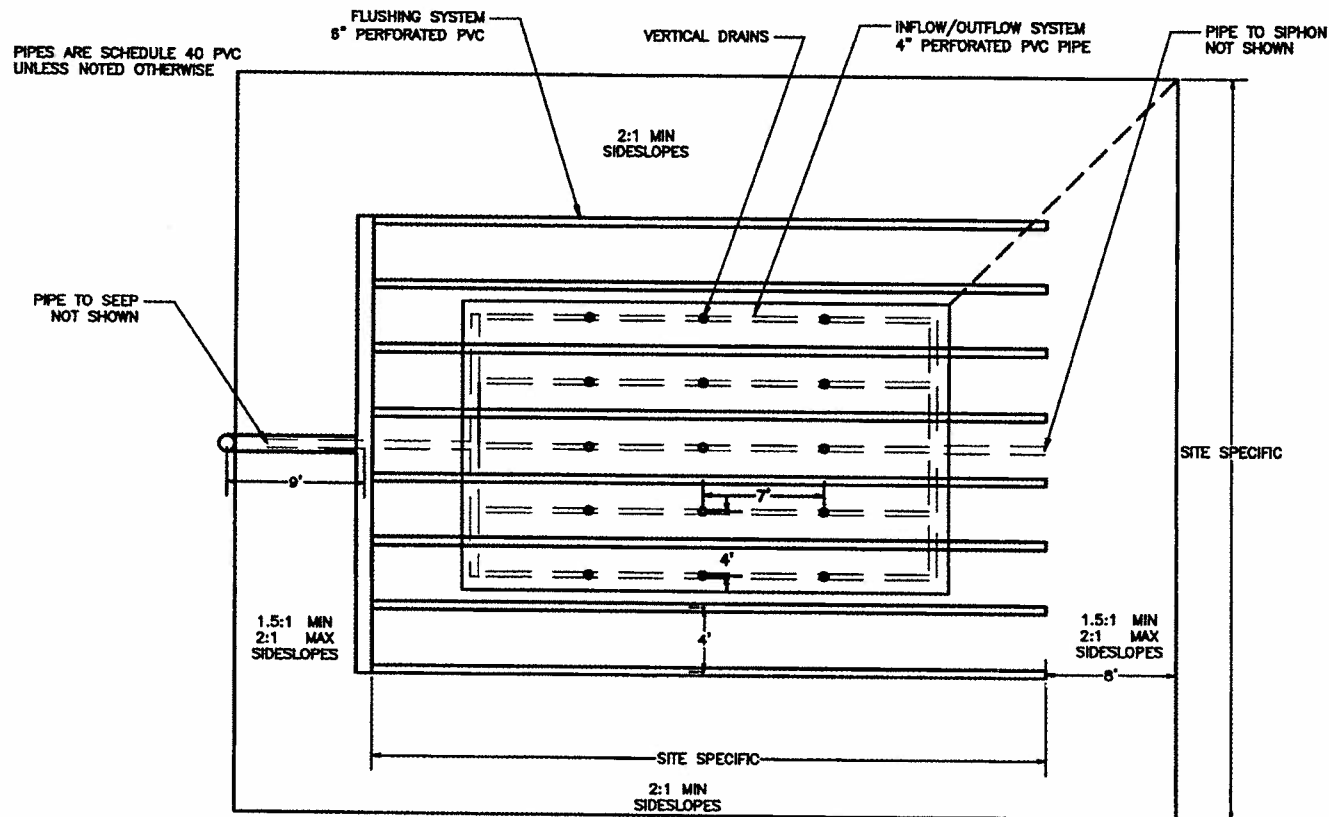



SIDE SLOPES ARE 2:1 MIN. INLET AND OUTLET SIDESLOPES MAY 1.5:1 MAX
THE ENTIRE ROCK BASIN IS WRAPPED IN A PVC LINER. SIDE AND BOTTOM SEAMS SHOULD BE SEALED TOGETHER WITH A
MANUFACTURER APPROVED METHOD. OVERLAP THE TOP COVER BY 2', DO NOT SEAL THE TOP. SEAL ALL JOINTS WITH PVC CEMENT
OR FOAM. INSTALL 4- 4"x4" POST 2" IN CONCRETE, AT CORNERS TO REFERENCE WHERE ALL CAPS ARE BURIED.

UPFLOW LIMESTONE POND
AMLWT 1

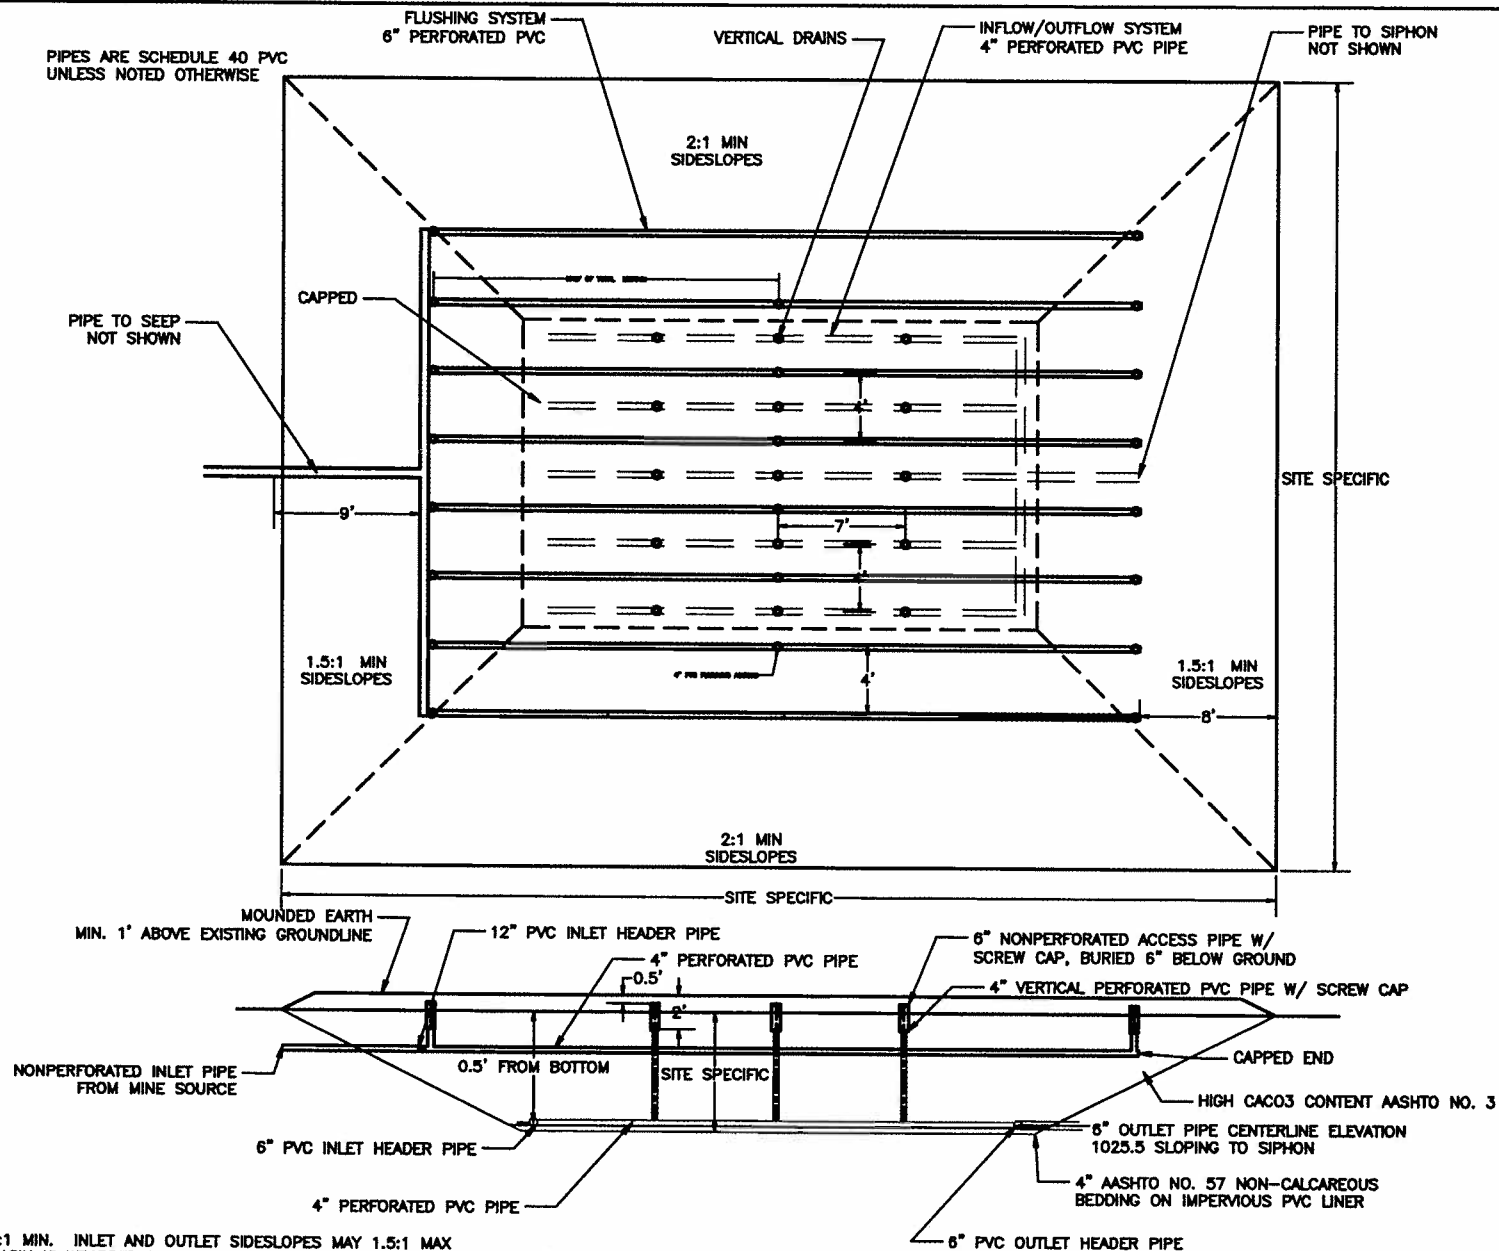


SIDE SLOPES ARE 2:1 MIN. INLET AND OUTLET SIDESLOPES MAY 1.5:1 MAX
THE ENTIRE ROCK BASIN IS WRAPPED IN A PVC LINER. SIDE AND BOTTOM SEAMS SHOULD BE SEALED TOGETHER WITH A
MANUFACTURER APPROVED METHOD. OVERLAP THE TOP COVER BY 2', DO NOT SEAL THE TOP. SEAL ALL JOINTS WITH PVC
CEMENT OR FOAM. INSTALL 4- 4"x4" POST 2' IN CONCRETE, AT CORNERS TO REFERENCE WHERE ALL CAPS ARE BURIED.


DOWNFLOW LIMESTONE POND
AMLWT 2

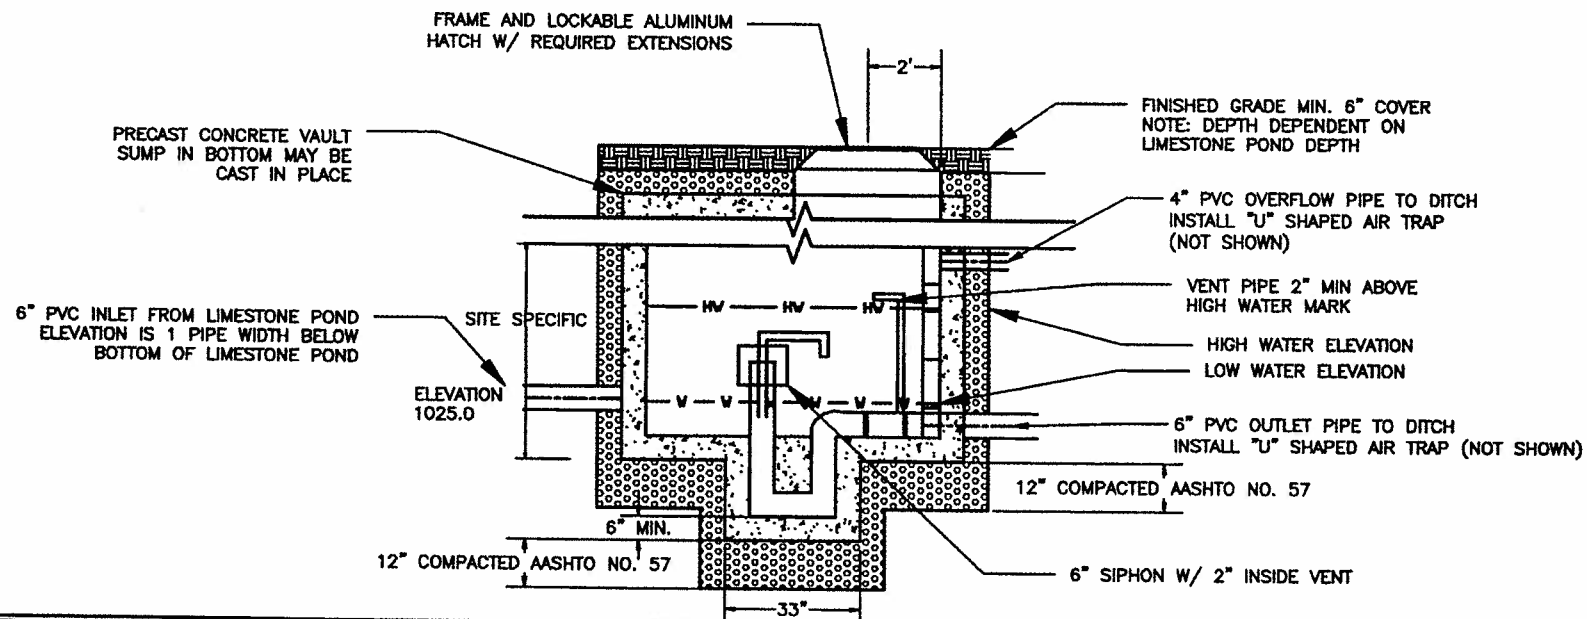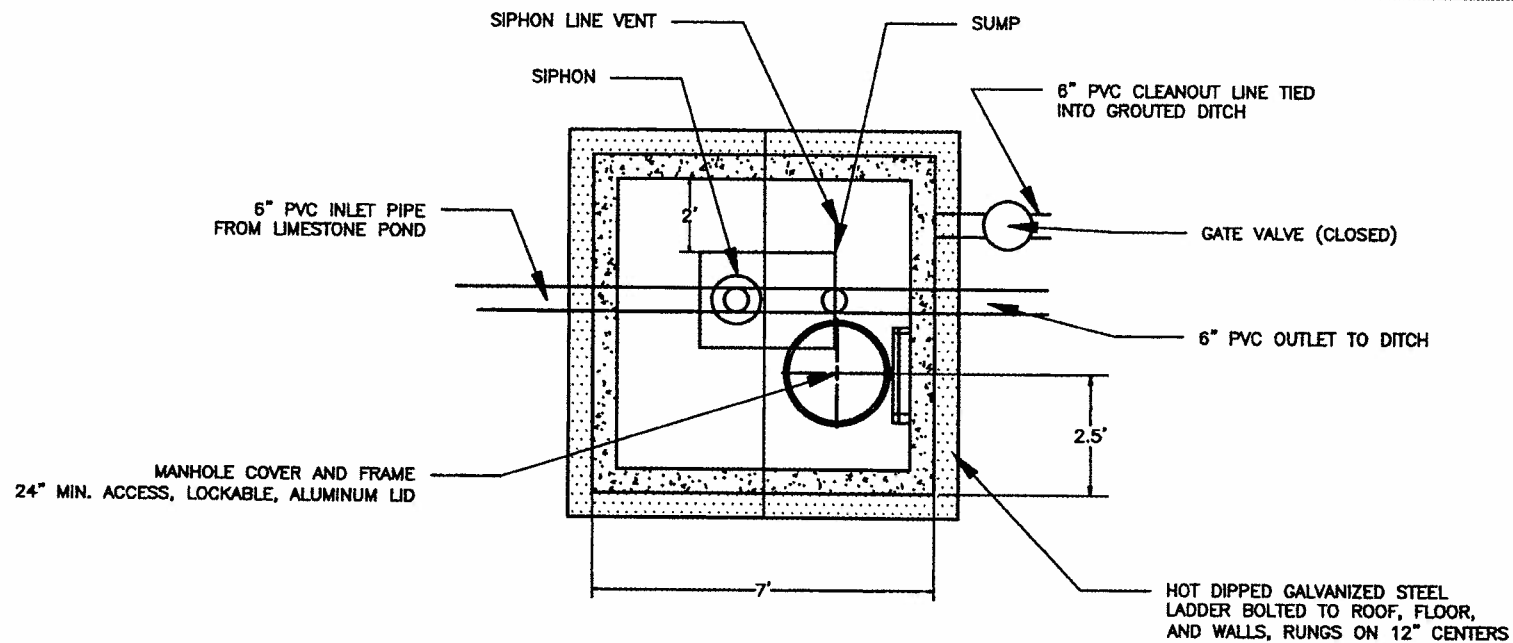

MANHOLE AND SIPHON SYSTEM
AMLWT 3

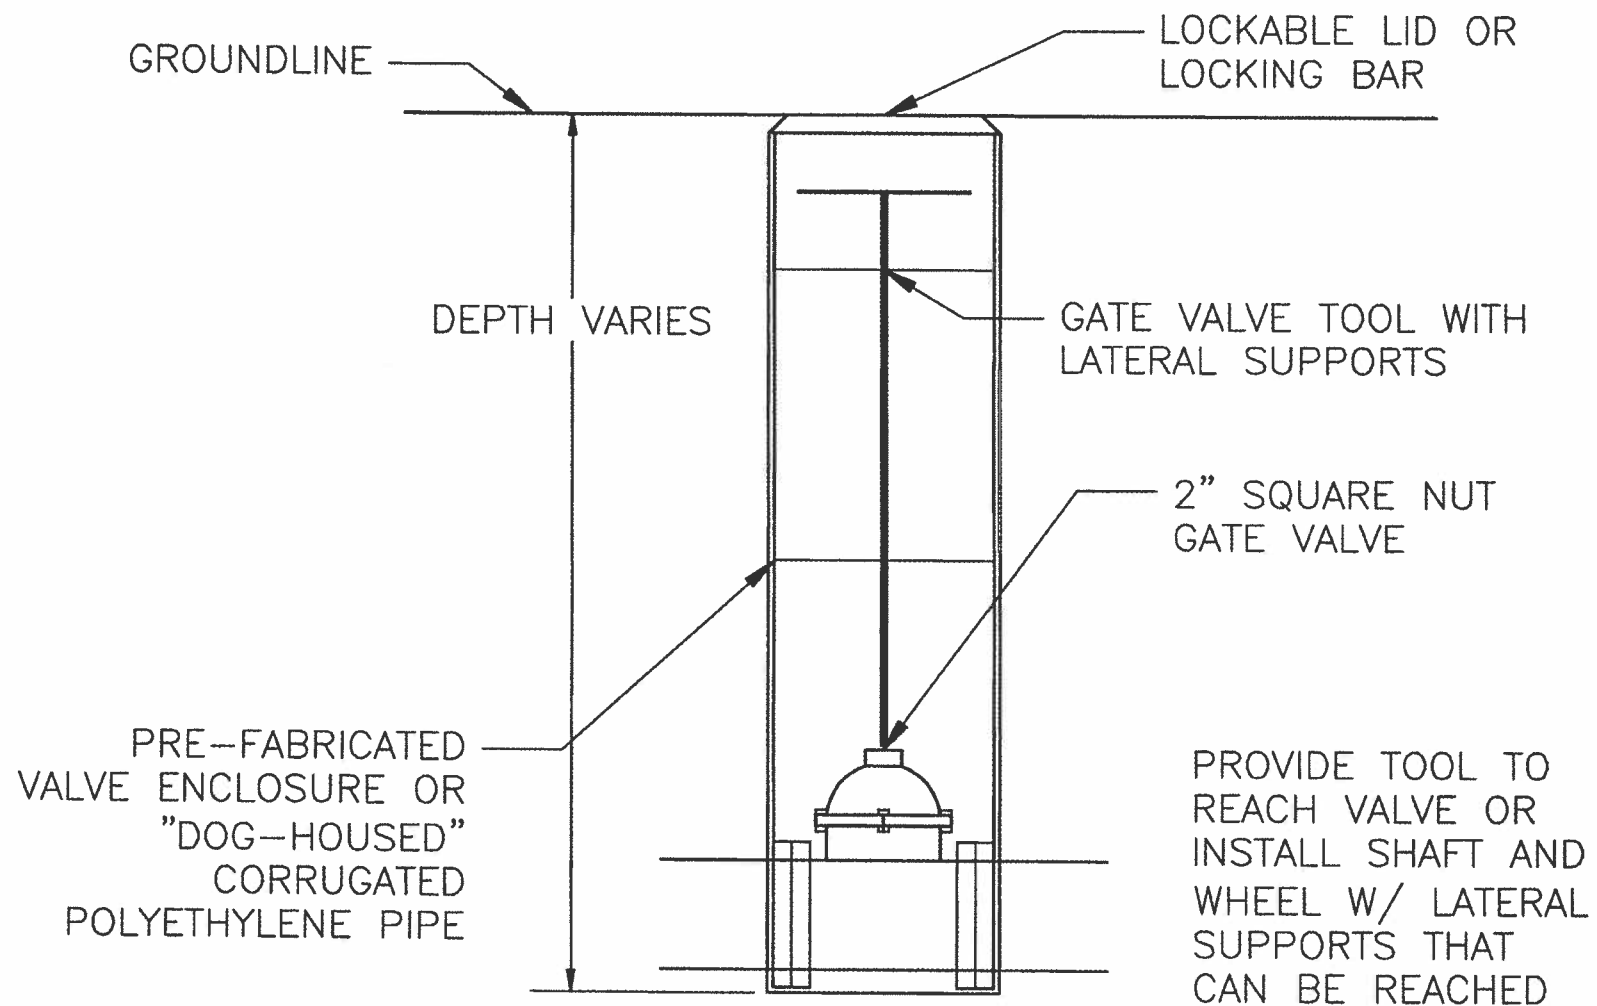

GATE VALVE AND HOUSING
AMLWT 4

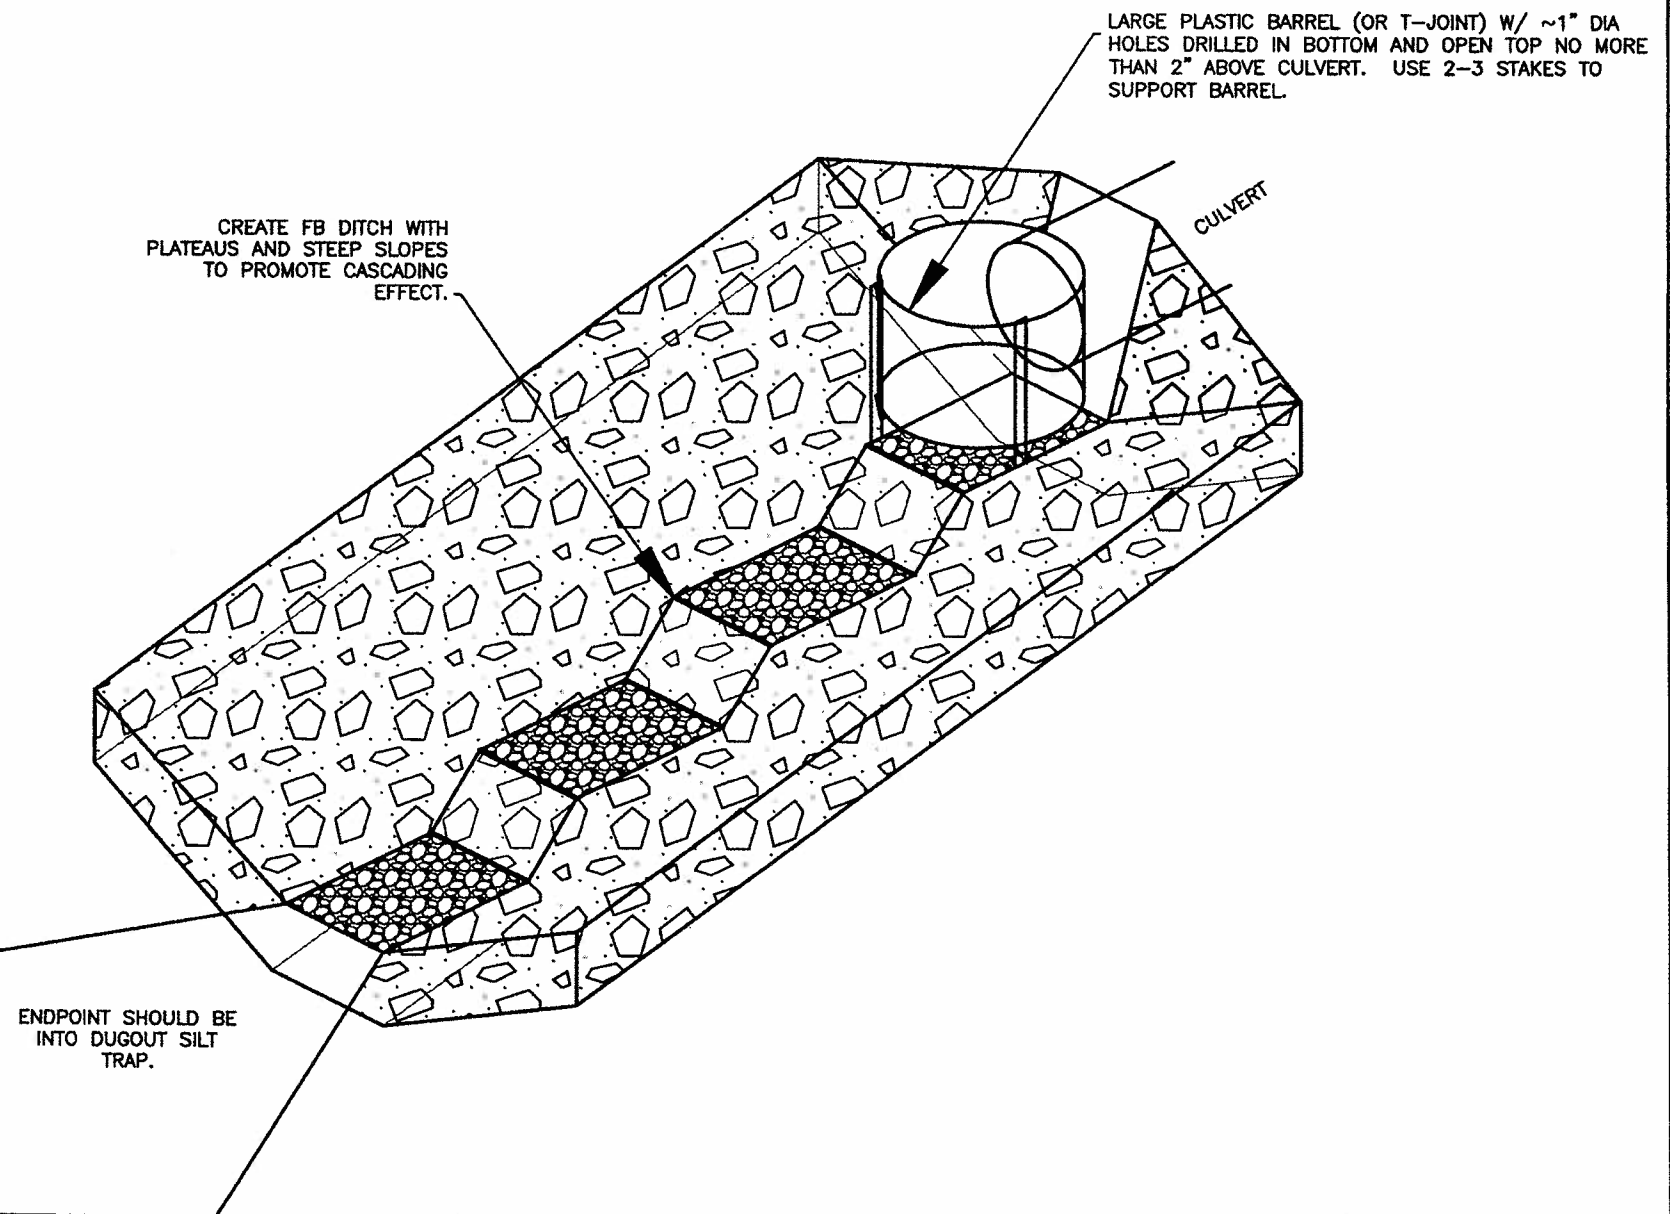

SEQUENTIAL AERATION DITCH
AMLWT 5

